


PLAN GENERAL STATIE DE EPURARE
WASTE WATER TREATMENT PLANT - GENERAL LAYOUT

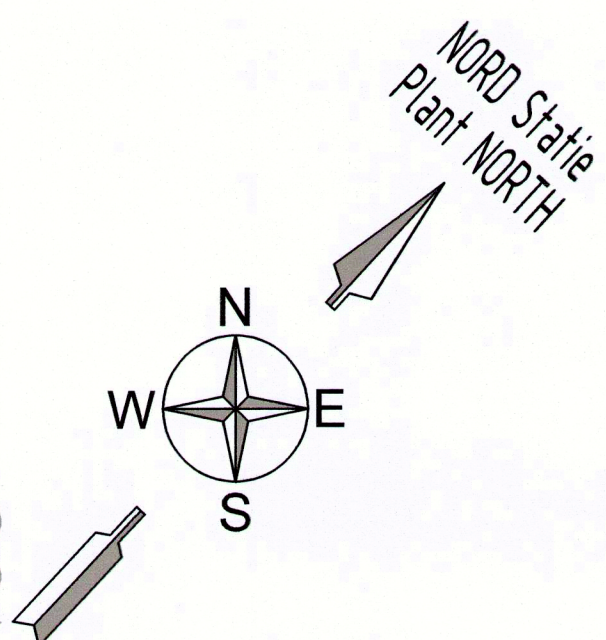

- 1-Line Building / Clădire var
- 2-Neutralization Tank / Bazin de neutralizare
- 3-Emergency Tank / Bazin de urgență
- 4-Lamella Clarifiers / Decantatoare lamelare
- 5-Sludge Flowmeter pit / Camera debitmetru namol
- 6-Buffer tank / Bazin tampon
- 7-Biological Area / Treapta de tratare biologică
- 8-Membrane Cassette Area / Zona casete cu membrane
- 9-Main Treatment Building / Clădire principală de tratare
- 10-Treated Water Tank / Bazin apă tratată
- 11-Effluent Flowmeter Chamber / Camera debitmetru ieșire
- 12-Sludge Buffer Tank / Bazin Tampon Namol
- 13-Dewatering Building / Clădire deshidratatoare
- 14-Administrative Pavilion / Pavilion administrativ
- 15-Workshop / Atelier
- 16-Transformer Station / Post TRAFU
- 17-Drainage collection tank / Bazin colectare drenaj
- 18-Service water tank / Bazin apă de serviciu
- 19-Domestic Wastewater Tank / Bazin colectare ape menajere
- 20-Storm water pit / Camin apă pluvială

LEGENDA TEREN/ BOND LEGEND:

	Cadastral number 108269 boundary limit/ Limita de proprietate numar cadastral 108269
	Cadastral number 108125 boundary limit/ Limita de proprietate numar cadastral 108125

INDICI DE PLAN GENERAL PROPUȘI	Valoare	UM
SUPRAFATA TEREN NR. CAD. 108125 SI 108269	33881.0	m ²
SUPRAFATA CONSTRUITA, Sc	5044.5	m ²
SUPRAFATA DESFASURATA, Sd	5966.6	m ²
SUPRAFATA PLATFORME SI PARCARI, Sp	5079.0	m ²
SUPRAFATA OCUPATA, Sc+Sp	10123.5	m ²
SUPRAFATA LIBERA DE CONSTRUCTII	23757.5	m ²
SPATII VERZI, Sv	23757.5	m ²
PROCENT SPATII VERZI	70.12%	%
POT	14.89%	%
CUT	0.18	

STATIA DE EPURARE APE UZATE SE INCADREAZA IN:

- CATEGORIA C DE IMPORTANTA (CONFORM HGR 766/1997)
- CLASA III DE IMPORTANTA (CONFORM P100/1-2013)
- GRADUL II DE REZISTENTA LA FOC (CONFORM P118-1999)
- CATEGORIE DE PERICOL DE INCENDIU E (RISC MIC DE INCENDIU)
(CONFORM P118-1999)

WASTE WATER TREATMENT PLANT IS INCLUDED IN:

- IMPORTANCE CATEGORY: C (ACC. TO HGR 766/1997)
- IMPORTANCE CLASS: III (ACC. TO P100/1-2013)
- FIRE RESISTANCE DEGREE: II (ACC. TO P118-1999)
- FIRE RISK CATEGORY: E (LOW FIRE RISK) (ACC. TO P118-1999)

[illegible]